


METER PEDESTAL/RACK SPECS (DUAL)

- * OPTIONAL- MOUNT UNISTRUT TO 2" SQUARE TUBING
- * MAIN DISCONNECT MUST BE WITHIN ONE FOOT OF THE METER BASE.
- * MUST HAVE PULL STRING INSIDE PVC CONNECTED TO METER BASE PRIOR TO FINAL INSPECTION.
- * METER BASE MUST BE GROUNDED
- * IF THE NIPPLE CONNECTING THE METER BASE TO THE EXTERNAL DISCONNECT IS PVC METER BASE MUST BE GROUNDED SEPARATELY. IF THE NIPPLE IS METAL THERE IS NO NEED FOR ADDITIONAL GROUNDING.

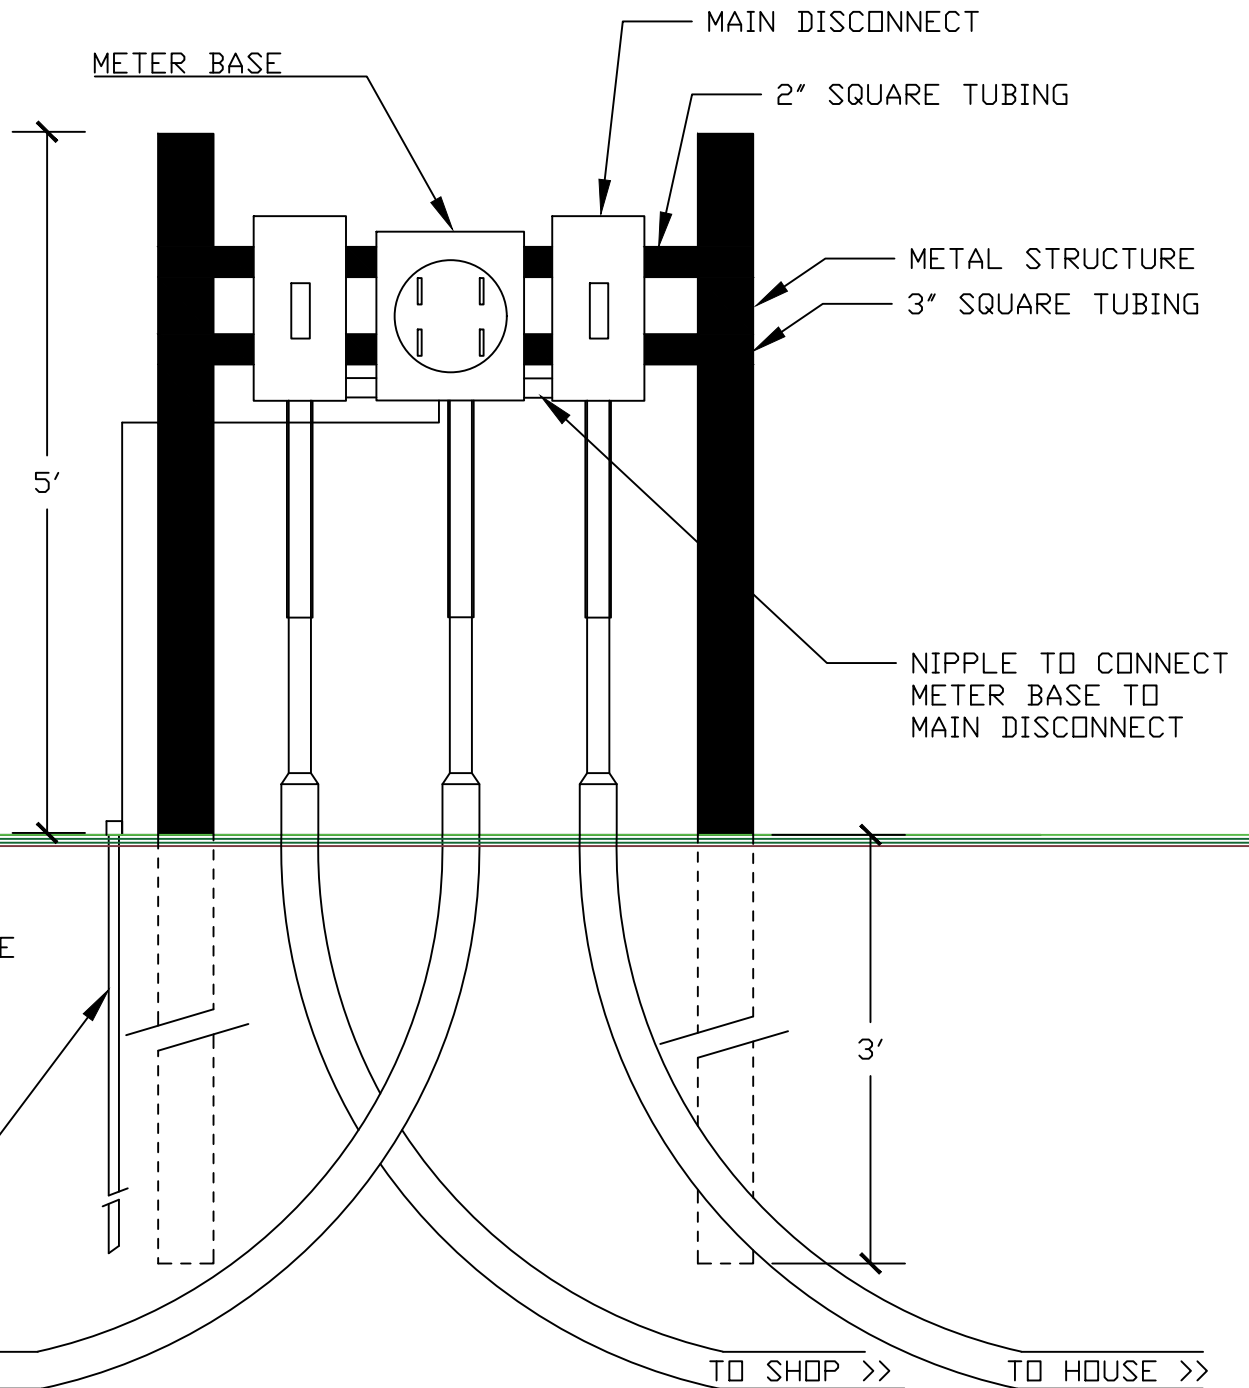

* SET POSTS IN CONCRETE

8' GROUND ROD

3" GRAY PVC

<< TO TRANSFORMER POLE

TO SHOP >>

TO HOUSE >>